




TRENCH CROSS SECTION - PILOT CABLES
Scale 1:10

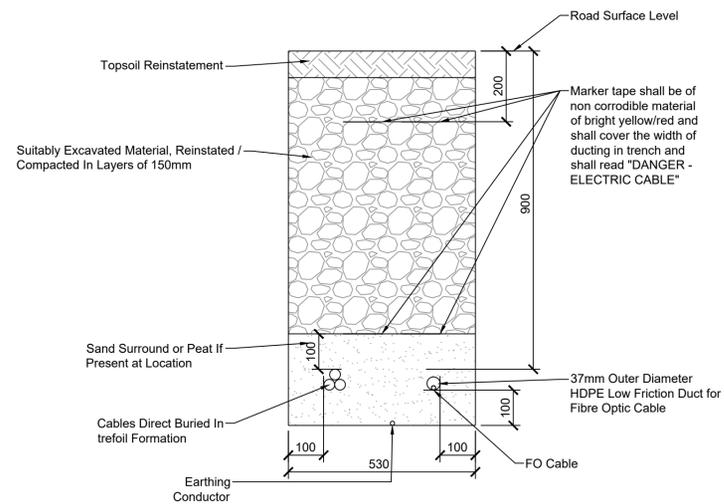


COLLECTOR CIRCUIT VERGE (DIRECT BURY)
Scale 1:10

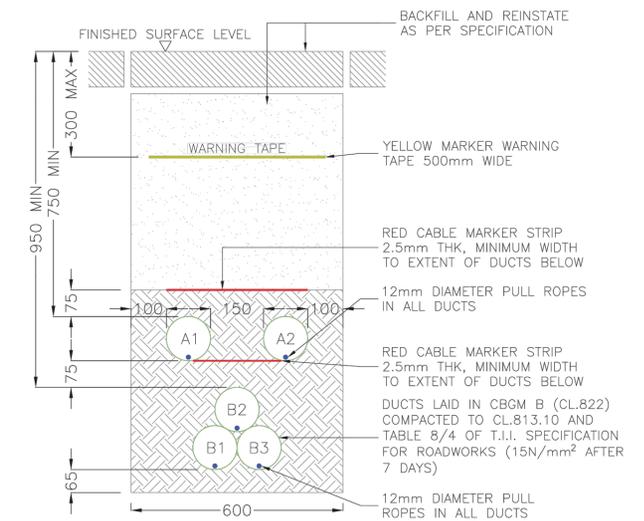


A=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6
B=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6
ALL DIMENSIONS IN MILLIMETERS
110kV SINGLE CIRCUIT TRENCH CROSS SECTION FOR POWER DUCTS IN TREFOIL FORMATION
Scale 1:10

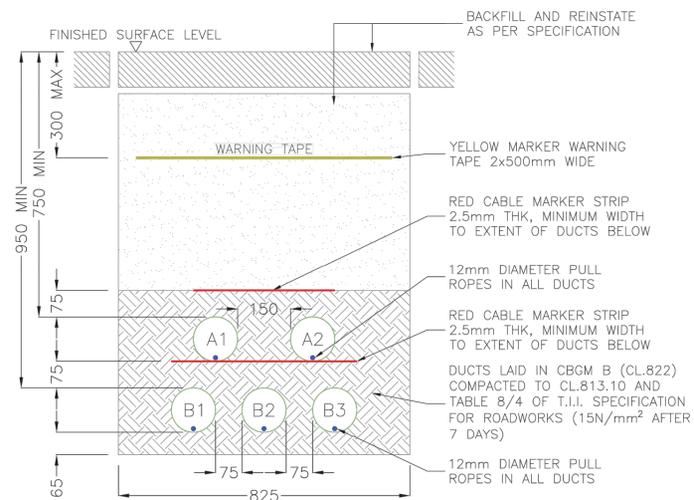


A=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6
B=125mm O.D. HDPE ESB APPROVED DUCT, SDR=17.6
ALL DIMENSIONS IN MILLIMETERS
110kV SINGLE CIRCUIT TRENCH CROSS SECTION FOR POWER DUCTS IN FLAT FORMATION
Scale 1:10

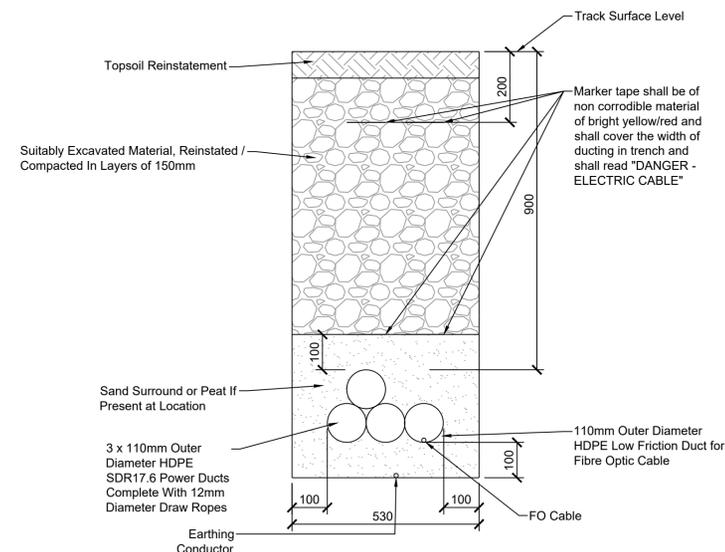

COLLECTOR CIRCUIT VERGE
Scale 1:10

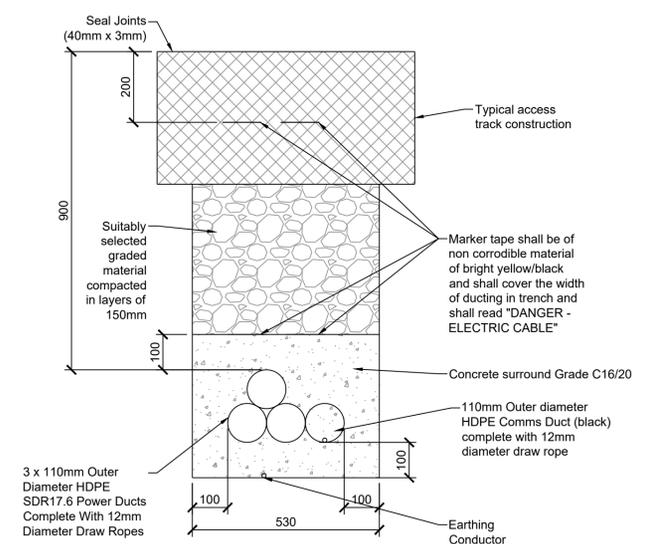

COLLECTOR CIRCUIT CENTRE
Scale 1:10



If Applicable : Ordnance Survey Ireland Licence No. EN 0001220 © Ordnance Survey Ireland and Government of Ireland

Rev.	Description	App By	Date
A	ISSUE FOR COMMENT	JH	19.12.19

PROJECT	CLIENT		
COOM GREEN ENERGY PARK	CROOM GREEN ENERGY PARK LIMITED		
SHEET	Date	Project number	Scale (@ A1-)
TRENCH DETAILS FOR INTERNAL COLLECTOR CABLES & 110KV GRID CONNECTION CABLE	19.12.19	P20-099	1:10
	Drawn by	Drawing Number	Rev
	SOC	P20-099-0300-0021	A
	Checked by		
	TB		